


VALVE BOX COVER, EAST JORDAN IRON
WORKS, EJIW 6800

ALIGN INTERNAL VALVE BOX NUBS IN THE
DIRECTON OF THE WATER MAIN (AS SHOWN)

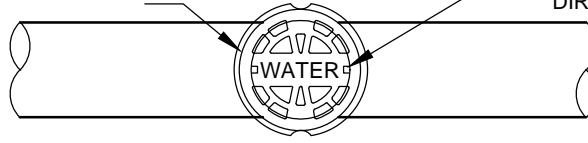


PLAN

NTS

NEW CONSTRUCTION

ADJUSTMENT OF EXISTING
VALVE BOX IN PAVEMENT

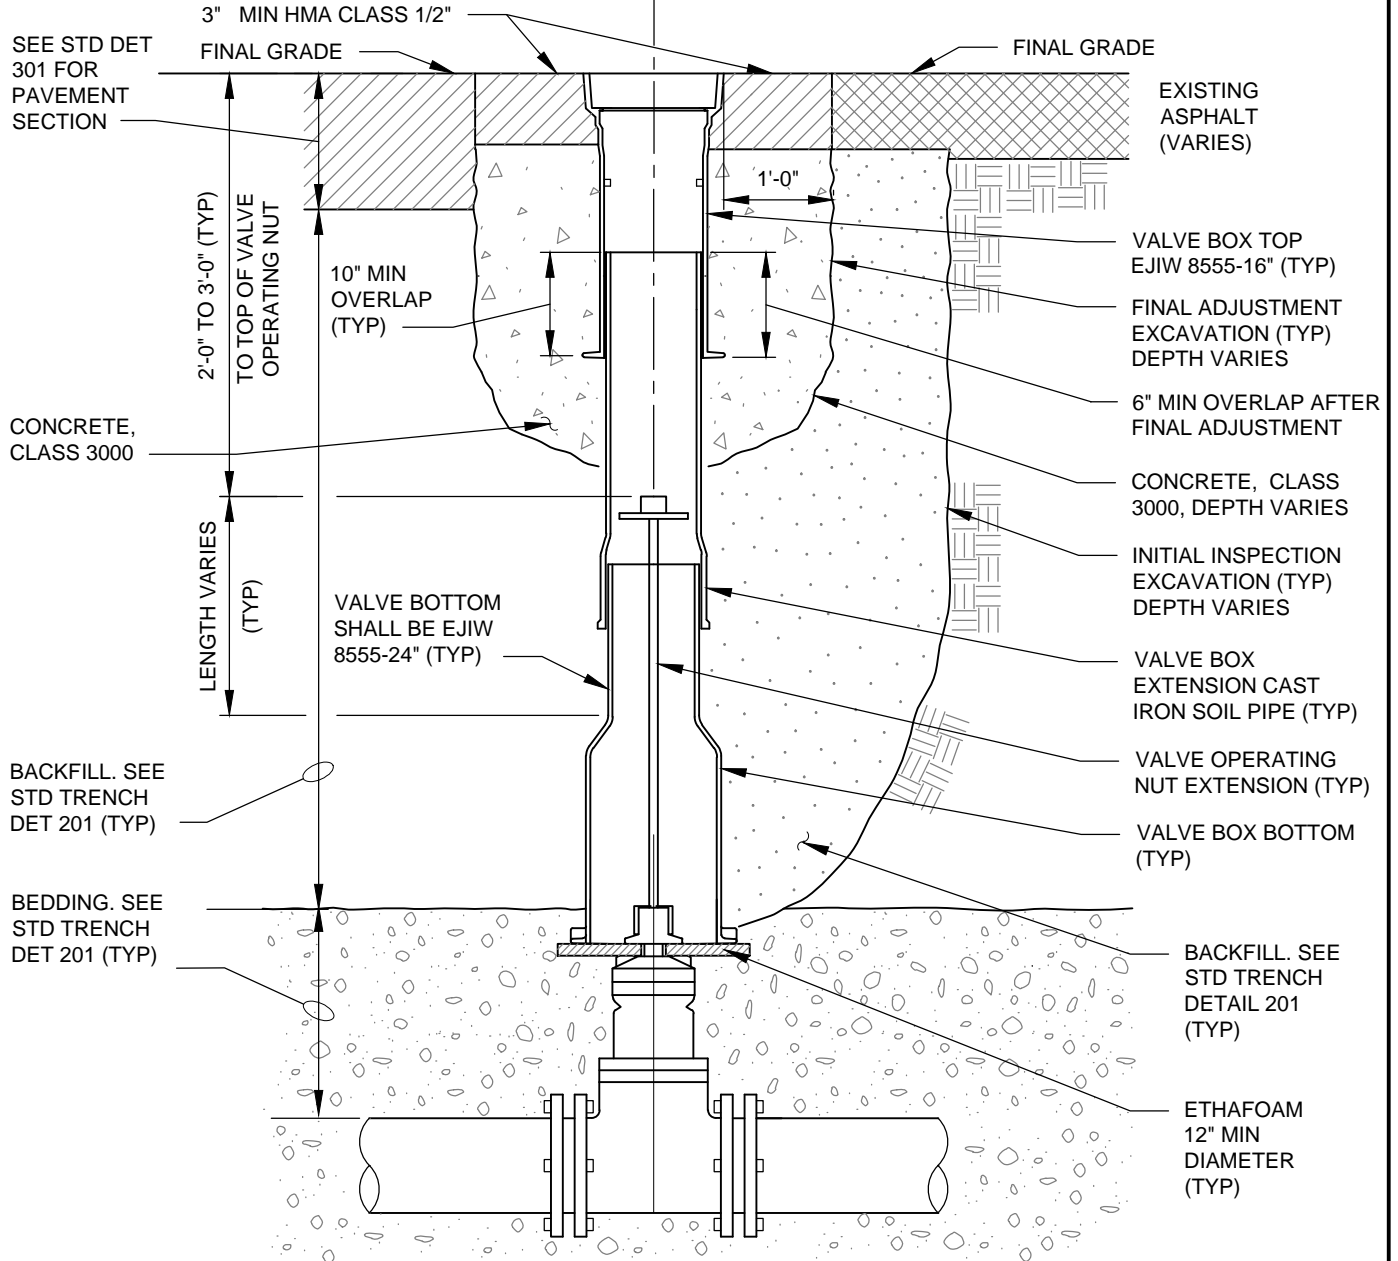

SECTION

NTS

NOTES:

1. ALL EXISTING VALVE BOXES IN NEW PAVEMENT AREAS SHALL BE REPLACED WITH THE LATEST MODEL.
2. VALVE BOX LIDS SHALL BE INSTALLED FLUSH WITH FINISHED GRADE.
3. UTILITY ADJUSTMENTS TO FINAL GRADE SHALL BE DONE **AFTER** THE PAVING OPERATIONS ARE COMPLETE.

Scott Thomasson

APPROVED BY: SCOTT THOMASSON
WATER/WASTEWATER ENGINEERING MANAGER

REVISION DATE: MARCH 01, 2017



City of Redmond
WASHINGTON

STANDARD DETAILS

VALVE BOX DETAIL

FILE NAME: SD718.DWG

DETAIL NUMBER: 718